

“H”

# Wastewater Feasibility Study

Ladera Vineyards Winery  
Minor Modification P21-00294-MOD and Viewshed P22-00109  
Planning Commission Hearing May 3, 2023

# **Wastewater Feasibility Study**

for

**Ladera Vineyards**

**3942 Silverado Trail N**

**Calistoga, Napa County, CA**

L A D E R A  
*Napa Valley*



**Winery Use Permit Minor Modification  
#P21-00294**

**Revised July 2022**



## TABLE OF CONTENTS

TABLE OF CONTENTS	1
ATTACHMENTS	1
1.0 PROJECT SUMMARY	2
1.1 SITE DESCRIPTION	2
1.1.1 Land Use	2
1.1.2 Water Use	2
2.0 WASTEWATER DEMAND	2
2.1 EXISTING DEMANDS	2
2.2 PROPOSED DEMANDS	3
2.2.1 Domestic Wastewater	3
2.2.2 Winery Process Wastewater	3
3.0 TREATMENT & DISPERSAL SYSTEM	4
3.1 EXISTING WASTEWATER SYSTEM	4
3.2 DOMESTIC WASTEWATER SYSTEM	5
SW Replacement Area	7
3.3 WINERY PROCESS WASTEWATER SYSTEM	7
PW Replacement Area	8
4.0 CAVE SETBACKS	8
5.0 CONCLUSION	9

## ATTACHMENTS

1. Wastewater Calculations
2. Vicinity Map, Septic Site Evaluation Report
3. Neighboring Septic System Research

## 1.0 PROJECT SUMMARY

The project is proposing a minor modification to an existing winery Use Permit under the Napa County Streamlining Ordinance (Ordinance No. 1455). The existing winery is located at 3942 Silverado Trail North in Calistoga, CA. The project is proposing a moderate staff and event increase and is maintaining the existing wine production limit of 20,000 gallons annually. The project proposes removal of existing structures, a new Type III cave for barrel aging, fermentation, and production offices, as well as a remodel of the existing tasting room building. The existing driveway will remain and be improved to meet current jurisdictional requirements as well as additional parking areas added.

The project also proposes three full time and two part time staff members. Proposed visitation to the winery includes 30 maximum visitors for winery tours and tastings daily and 210 maximum visitors per week. Two semi-annual wine club events for up to 50 guests will be held approximately every six months. Food service at marketing events will include food and wine pairing dinners. All food service is to be catered and consistent with the definitions of "Tours and Tastings" and "Marketing of Wine" per the Napa County Code.

This study and the associated Use Permit Drawings will demonstrate that wastewater generated from the proposed projects can be treated and dispersed onsite per jurisdictional requirements.

### 1.1 SITE DESCRIPTION

The 7.44-acre subject parcel is located off Silverado Trail between Calistoga and St. Helena in the unincorporated area of Napa County. The south westerly portion of the subject parcel that borders the Silverado Trail is relatively flat with slopes less than five percent. The parcel then slopes upward away from Silverado Trail and consists primarily of dense woodland cover.

#### 1.1.1 *Land Use*

The property sits at the border of the Napa Valley region which is predominantly Agricultural Preserve and Watershed (AP and AW) zoned parcels. These parcels consist of existing vineyards, wineries, and residences. The subject parcel is currently developed with an existing residence as well as an older winery and barn structures. An existing vineyard, landscaped areas, and driveway are also located within the flatter portion of the subject parcel. The current land use of the subject parcel is consistent with the proposed improvements summarized above.

#### 1.1.2 *Water Use*

The site is serviced by two existing onsite wells. The existing wells are located within the Napa Valley Floor-Calistoga groundwater zone.

## 2.0 WASTEWATER DEMAND

### 2.1 EXISTING DEMANDS

Existing wastewater records were not available for the subject parcel and have not been quantified as part of this analysis.

## 2.2 PROPOSED DEMANDS

The proposed project will produce two (2) separate wastewater streams. Domestic wastewater is generated by the residence and employee break room and lavatory use as well as tasting/event visitor lavatory use. All catered meals will be prepared offsite and therefore kitchen wastewater will not be generated onsite. Process wastewater is generated by winemaking activities including but not limited to grape crushing, fermentation, and equipment cleaning/sanitization.

### 2.2.1 Domestic Wastewater

Domestic wastewater from the proposed project will be generated by employees and visitors as well as the existing residence. The existing residence is not occupied year-round; however, wastewater generation rates will be calculated based on the number of potential bedrooms. A bedroom generation rate of 120 gallons per bedroom is utilized to estimate domestic wastewater flows. The existing residence will be retrofitted with low flow fixtures to reduce wastewater and water usage on the site. The existing residence contains three potential bedrooms. The domestic wastewater flow generated by the residence is estimated below:

$$3 \text{ bedrooms} \quad \times \quad 120 \text{ gallons per bedroom per day} \quad = 360 \text{ gallons per day (GPD)}$$

Winery domestic wastewater flows are estimated based on the maximum day scenario to capture peak flows. A peak wastewater flow scenario would occur on a day with maximum visitation and an event. The tasting room is closed during days where an event is held.

0 daily visitors	$\times$	3 gallons per visitor per day	= 0 gpd
5 staff members	$\times$	15 gallons per employee per day	= 75 gpd
50 event guests	$\times$	3 gallons per guest per day	= 150 gpd

$$\text{Total} \quad = 225 \text{ gpd}$$

The generation rates used in the calculations above are based on current Napa County Regulations<sup>1</sup>.

The total domestic wastewater flow is the sum of the residential and winery domestic wastewater flows. Based on the itemized calculations above, the resulting **total domestic wastewater flow is calculated to be 585 gpd**.

Refer to the attached wastewater calculations for both event and non-event day wastewater calculations.

### 2.2.2 Winery Process Wastewater

Winery process wastewater consists of non-domestic wastewater generated by winemaking activities. This primarily results from cleaning and sanitizing equipment, crushing grapes, and fermenting wine. The peak day scenario for winery process wastewater occurs during the harvest winemaking season. This typically spans from the end of August to the end of October. During this period, approximately 30 to 40 percent of annual wastewater flows are generated.

---

<sup>1</sup> Refer to Table II-1 Commercial Design Flowrates from the Napa County Onsite Wastewater Treatment Systems (OWTS) Technical Standards, Final Draft

Winery process wastewater is calculated based on the Regional Water Quality Control Board (RWQCB) General Waste Discharge Requirements for Winery Process Water. This study assumes a winemaking generation rate of six gallons of water used per gallon of wine produced. This generation rate is within the industry standard for sizing winery wastewater (WW) treatment systems. At a peak production level of 20,000 gallons per year (gpy), the total annual flow is calculated below:

$$20,000 \text{ gallons of wine per year} \times 6 \text{ gallons of WW/wine} = 120,000 \text{ gpy}$$

Assuming 35% of the total annual flow is produced over the harvest period, the average harvest flow is calculated below:

$$\begin{aligned} \underline{35\% \times 120,000 \text{ gallons per year}} \\ 45 \text{ days} = 933 \text{ gpd} \end{aligned}$$

A peaking factor of 1.5 is applied to the calculated flow to provide a conservative estimate of flows during high peak usage. **The peak process wastewater design flow is calculated to be 1,400 gpd.**

Based on the permit production limit and the annual wastewater flow, the winery falls under Tier 2 requirements. The following table is from the Unofficial Adoption Copy which is the most recently published version of the forthcoming General Waste Discharge Requirements for Winery Process Water.

*Table 1 RWQCB General Order Table 1*

**Table 1. Tier Determination**

Tier	Facility process water flow <sup>(1)</sup> (gal/yr)
Exempt	<10,000
Tier 1	10,000 – 30,000
Tier 2	30,001 – 300,000
Tier 3	300,001 – 1,000,000
Tier 4	1,000,001 – 15,000,000

### 3.0 TREATMENT & DISPERSAL SYSTEM

#### 3.1 EXISTING WASTEWATER SYSTEM

The project site includes an existing septic system that consists of a septic tank and conventional gravity leachfield. The existing septic system is proposed to be removed per Napa County Planning, Building, and Environmental Services (PBES) requirements as part of the proposed improvements.

### **3.2 DOMESTIC WASTEWATER SYSTEM**

The domestic wastewater system for the winery and residence is proposed to include a subsurface drip dispersal system. A site evaluation was performed on November 17, 2021, by Christina Nicholson and Vincent Hart-Tinsley of Sherwood Design Engineers. Test pits were excavated by McCollum General Engineering and Maureen Shields-Bown of Napa County Environmental Health visited the site to inspect soil conditions. Test pits 1-8 showed suitable soil for the installation of a subsurface drip field and required replacement area within the areas observed during the site evaluation. The location of the test pits are shown on the Use Permit Minor Modification Drawings (see sheet C3.0). A copy of the Site Evaluation Report is included in Attachment 2.

Based on findings from the site evaluation, a subsurface drip dispersal field is proposed for the SW system. The drip field will be located near test pit 4 which has Sandy Loam soils and a suitable depth greater than 24 inches. A pretreatment system will be utilized to meet secondary effluent requirements prior to entering the drip field. The pretreatment system will include a septic tank, a recirculation/dosing tank and an Orenco Systems AdvanTex AX20 filter pod. This method of treatment and dispersal provides a small footprint. Design of the subsurface drip field will include landscaping to help with evapotranspiration of wastewater and will include beneficial plants to promote a diversified insect habitat. Below is a list of beneficial plants that could be incorporated into the insectary / subsurface drip field area.

*Figure 1 Dispersal Field Plant Types*

Name		Promotes Species	Type
Creek Dogwood	<i>Cornus sericea</i>	Bird, Butterfly	Winter Deciduous
California Wildrose	<i>Rosa californica</i>	Bird, Butterfly, Bee	Winter Deciduous
Cream Bush	<i>Holodiscus discolor</i>	Butterfly	Winter Deciduous
Dark Star Ceanothus	<i>Ceanothus 'Dark Star'</i>	Bee, Bird	Evergreen

Import soil fill will be utilized to cover the drip field and provide a cover depth of eight inches per Napa County PBES and Geoflow requirements to minimize leachfield trenching. The application rate for the drip field is based on GeoFlow's Application Rates for Sandy Loam Soil that includes 0.9 gallons per square foot per day (see table below).

*Table 2 GeoFlow Application Rate Table*

**TABLE 1**

**DRIP LOADING RATES CONSIDERING SOIL STRUCTURE.**

Table 1 is taken from the State of Wisconsin code and was prepared by Jerry Tyler.

Provided for guidelines and budgeting purposes. Refer to your local regulations and qualified soil scientists to determine best loading rates.

Soil Textures	Soil Structure	Maximum Monthly Average $BOD_5 < 30 \text{ mg/L}$ $TSS < 30 \text{ mg/L}$ (gallons/ $\text{ft}^2/\text{day}$ )	Maximum Monthly Average $BOD_5 > 30 \text{ mg/L}$ $TSS > 30 \text{ mg/L}$ (gallons/ $\text{ft}^2/\text{day}$ )
Course sand or coarser	N/A	1.6	0.4
Loamy coarse sand	N/A	1.4	0.3
Sand	N/A	1.2	0.3
Loamy sand	Weak to strong	1.2	0.3
Loamy sand	Massive	0.7	0.2
Fine sand	Moderate to strong	0.9	0.3
Fine sand	Massive or weak	0.6	0.2
Loamy fine sand	Moderate to strong	0.9	0.3
Loamy fine sand	Massive or weak	0.6	0.2
Very fine sand	N/A	0.6	0.2
Loamy very fine sand	N/A	0.6	0.2
Sandy loam	Moderate to strong	0.9	0.2

Based on the peak daily flow and soil application rate, the required minimum required area for the drip field is calculated to be 650 sf. A summary of the configuration of the drip field is summarized below.

*Table 3 Drip Field Design*

Test Pit Location (primary area)	TP #4		
Soil Type	Sandy Loam		
Soil Application Rate	0.9	gal/sf/day	Per GeoFlow
Soil Depth	24 inches		Fill added
System Type	Subsurface Drip		
Field Size	650	sf	
Lateral Length	35	lf	
Lateral Spacing	2	ft	
Number of Laterals	10		
Total Area Provided	700	sf	
Number of Zones	1		

Area per Zone	700	sf
Test Pit Location (replacement area)	TP #7 & 8	
Soil Type	Sandy Loam	
Soil Application Rate	0.9	gal/sf/day <i>Per GeoFlow</i>
Soil Depth	24 inches	
System Type	Subsurface Drip	
200% Area	1,400	sf

Adequate area is available for the primary area as well as the required 200% replacement area as shown on the associated Plans within the vicinity of suitable soil observed during the above referenced site evaluation. The subsurface drip field contains one zone that includes 10 lines each 35 lineal feet (lf) long. This provides a total area 700 sf.

#### *SW Replacement Area*

The replacement area is proposed near test pits 7 and 8 which also have a soil texture of Sandy Loam. The application rate is the same as the primary field. The 200% required area is determined to be 1,400 sf. Both primary and replacement areas will be located outside all Napa County PBES setback requirements as shown on the attached plans. Notes for minimizing trenching and earth disturbing activities are also shown on sheet C3.0.

### **3.3 WINERY PROCESS WASTEWATER SYSTEM**

The winery process wastewater system is proposed to include a pretreatment system followed by surface dispersal on vineyard and landscape irrigation areas and will be designed per RWQCB and PBES requirements. A pressure distribution leachfield is proposed as the 100% replacement area.

The process wastewater treatment system will consist of an equalization tank (sized for three days storage minimum during harvest flows), a packaged treatment system (similar to Lyve Systems or Cloacina), a controls system, and a storage tank. This type of treatment system is the industry standard for winery wastewater treatment.

The storage tank will be sized to account for rainy days when treated wastewater is not permitted for surface application. Treated process wastewater will be used for surface drip irrigation on the 0.75 acres of vineyard and landscaped areas shown on sheet C3.0. Once a final utility plan has been developed and all setbacks have been determined, additional areas for landscape irrigation may be available.

A wastewater and irrigation balance will be performed following approval of the Use Permit Modification to establish the storage tank size and irrigation programming required. Underground treatment tanks are preferred and will be located outside an areas of cultural resource concern as identified by the project archaeologist.

*PW Replacement Area*

The replacement area is proposed to be PW leachfield located near the existing leachfield to minimize new trenching and near test pit 6 which is consistent with the soil profile described above under the Sanitary Wastewater Design.

Below is a summary of the proposed PD leachfield for the PW system:

*Table 2 PW PD Leachfield Design*

TEST PIT INFORMATION		
Design Test Pits	6 & 7	
Soil Type	Sandy Loam	
Soil Application Rate	0.8	gal/sf/day
Min Soil Depth	60	in
System Type	Pressure Distribution	

TRENCH DESIGN		
Fill Over Leachfield	12	in
Backfill/native Soil Depth (12-18 in)	0	in
Depth above pipe (2 in)	2	in
Depth to groundwater (36 in min STE, 24 in max PTE)	36	in
	18	in
Trench width	18	in
Calculated sidewall	3.00	sf/lf

LEACHFIELD DESIGN		
Field Size	583	lf
Lateral Length	50	lf
Trench Spacing	5	ft
Lateral Spacing	5.8	
Number of Laterals	12	
Total LF provided	600	lf

A 600 lf PD Leachfield located within fill and is proposed for the replacement area.

#### 4.0 CAVE SETBACKS

Per Napa County Code Section 13.28.040, the cave setbacks are achieved on this site and shown on sheet C0.0 for the subject and neighboring parcels. Based on the setbacks from the proposed cave location, only APN 021-030-002 falls within the setback location. Parcel research was conducted to determine the location of the septic system on this parcel via the Napa County Planning, Building and Environmental Services Electronic Document Retrieval website at countyofnapa.org. The septic system for this parcel is located outside the cave setback and is shown on sheet C0.0. The existing septic system for parcel 021-030-002 is shown in attachment 3.

## 5.0 CONCLUSION

The Use Permit Minor Modification is proposing a moderate increase to the staff and marketing plan. Winery production is not proposed to increase. The proposed wastewater improvements presented in this feasibility study will enhance the method of wastewater that is currently used by the facility which includes a combined conventional leachfield type system without pretreatment. The proposed wastewater improvements are shown on C3.0 of the Use Permit Minor Modification Drawings. The proposed wastewater treatment and dispersal methods will be constructed in areas outside cultural resource concern and above grade to the greatest extent possible.

**Attachment 1:**

Wastewater Calculations



### Design Parameters

#### Residence Domestic Wastewater

No.	Description	Generation Rate (gpd/bedroom)	Total (gpd)	Notes
	3 Bedrooms in the main residence	120	360	<i>Residence will be retrofitted to be low flows</i>
<b>Total Peak Daily Flow (Residence)</b>				<b>360</b>

#### Winery Domestic Wastewater

No.	Description	Generation Rate (gpd/person)	Total (gpd)	
	0 Daily Visitors	3	0	
	50 Event Guests	3	150	<i>During an event the tasting room will be closed</i>
	5 Staff Members	15	75	
<b>Total Peak Daily Flow (Winery)</b>				<b>225</b>

#### Peak Daily Flow

Residence Domestic Wastewater	360 gpd
Winery Domestic Wastewater	225 gpd
<b>Total Peak Daily Flow (all sources)</b>	<b>585 gpd</b>



### Design Parameters

#### Residence Domestic Wastewater

No.	Description	Generation Rate (gpd/bedroom)	Total (gpd)	Notes
	3 Bedrooms in the main residence	120	360	<i>Residence will be retrofitted to be low flows</i>
<b>Total Peak Daily Flow (Residence)</b>				<b>360</b>

#### Winery Domestic Wastewater

No.	Description	Generation Rate (gpd/person)	Total (gpd)	
	30 Daily Visitors	3	90	
	0 Event Guests	3	0	<i>Represents a non-event day at the winery</i>
	5 Staff Members	15	75	
<b>Total Peak Daily Flow (Winery)</b>				<b>165</b>

#### Peak Daily Flow

Residence Domestic Wastewater	360 gpd
Winery Domestic Wastewater	165 gpd
<b>Total Peak Daily Flow (all sources)</b>	<b>525 gpd</b>



## Design Parameters

### Soil Conditions

Test Pit Location (primary area)	TP #4		
Soil Type	Sandy Loam		
Soil Application Rate	0.9	gal/sf/day	Per GeoFlow
Soil Depth	24 inches		Fill added
System Type	Subsurface Drip		
Field Size	650	sf	
Lateral Length	35	lf	
Lateral Spacing	2	ft	
Number of Laterals	10		
Total Area Provided	700	sf	
Number of Zones	1		
Area per Zone	700	sf	
Test Pit Location (replacement area)	TP #7 & 8		
Soil Type	Sandy Loam		
Soil Application Rate	0.9	gal/sf/day	Per GeoFlow
Soil Depth	24 inches		Fill added
System Type	Subsurface Drip		
200% Area	1,400		

### Treatment Tank Sizing

Proposed Septic Tank Volume	1,500	gallons	
Total Septic Tank Volume	1,500	gallons	
Provided HRT	2.6	days	2.5 days minimum per Orenco/County
Recirculation Tank Volume	1,000	gallons	
Provided HRT	1.7	days	1 day minimum per Orenco
Dosing Tank Volume	1,000	gallons	
Provided HRT	1.7	days	1.5 days minimum per Orenco/County

### Orenco AdvanTex Pretreatment System Sizing

Application Rate	20	gpd/sf	per Orenco for Commercial Design
Minimum Required Area	29.25	sf	
Number of AX20's Proposed	2		
Area per AX20	20	sf	
Total Area Provided	40	sf	



## Design Parameters

### WINERY WASTEWATER FLOWS

Description	No.	Notes
Wine Production	20,000	gallons/year
Wine Generation Rate	6	gallons of ww/ gallon of wine/year
Annual Wastewater Production	120,000	gallons ww/year
Length of Harvest	45	days
Wastewater Produced During Harvest	35%	
Process Wastewater Flow	933	gallons/day
Peaking Factor	1.5	
<b>Peak Process Wastewater Flow</b>	<b>1,400</b>	<b>gallons/day</b>



### Design Parameters

#### TEST PIT INFORMATION

Design Test Pits	6 & 7	
Soil Type	Sandy Loam	
Soil Application Rate	0.8	gal/sf/day
Min Soil Depth	60	in
System Type	Pressure Distribution	

#### TRENCH DESIGN


Fill Over Leachfield	12	in
Backfill/native Soil Depth (12-18 in)	0	in
Depth above pipe (2 in)	2	in
Depth to groundwater (36 in min STE, 24 in max PTE)	36	in
	18	in
Trench width	18	in
Calculated sidewall	3.00	sf/lf

#### LEACHFIELD DESIGN

Field Size	583	lf
Lateral Length	50	lf
Trench Spacing	5	ft
Lateral Spacing	5.8	
Number of Laterals	12	
Total LF provided	600	lf

**Attachment 2:**

Vicinity Map, Site Evaluation Report

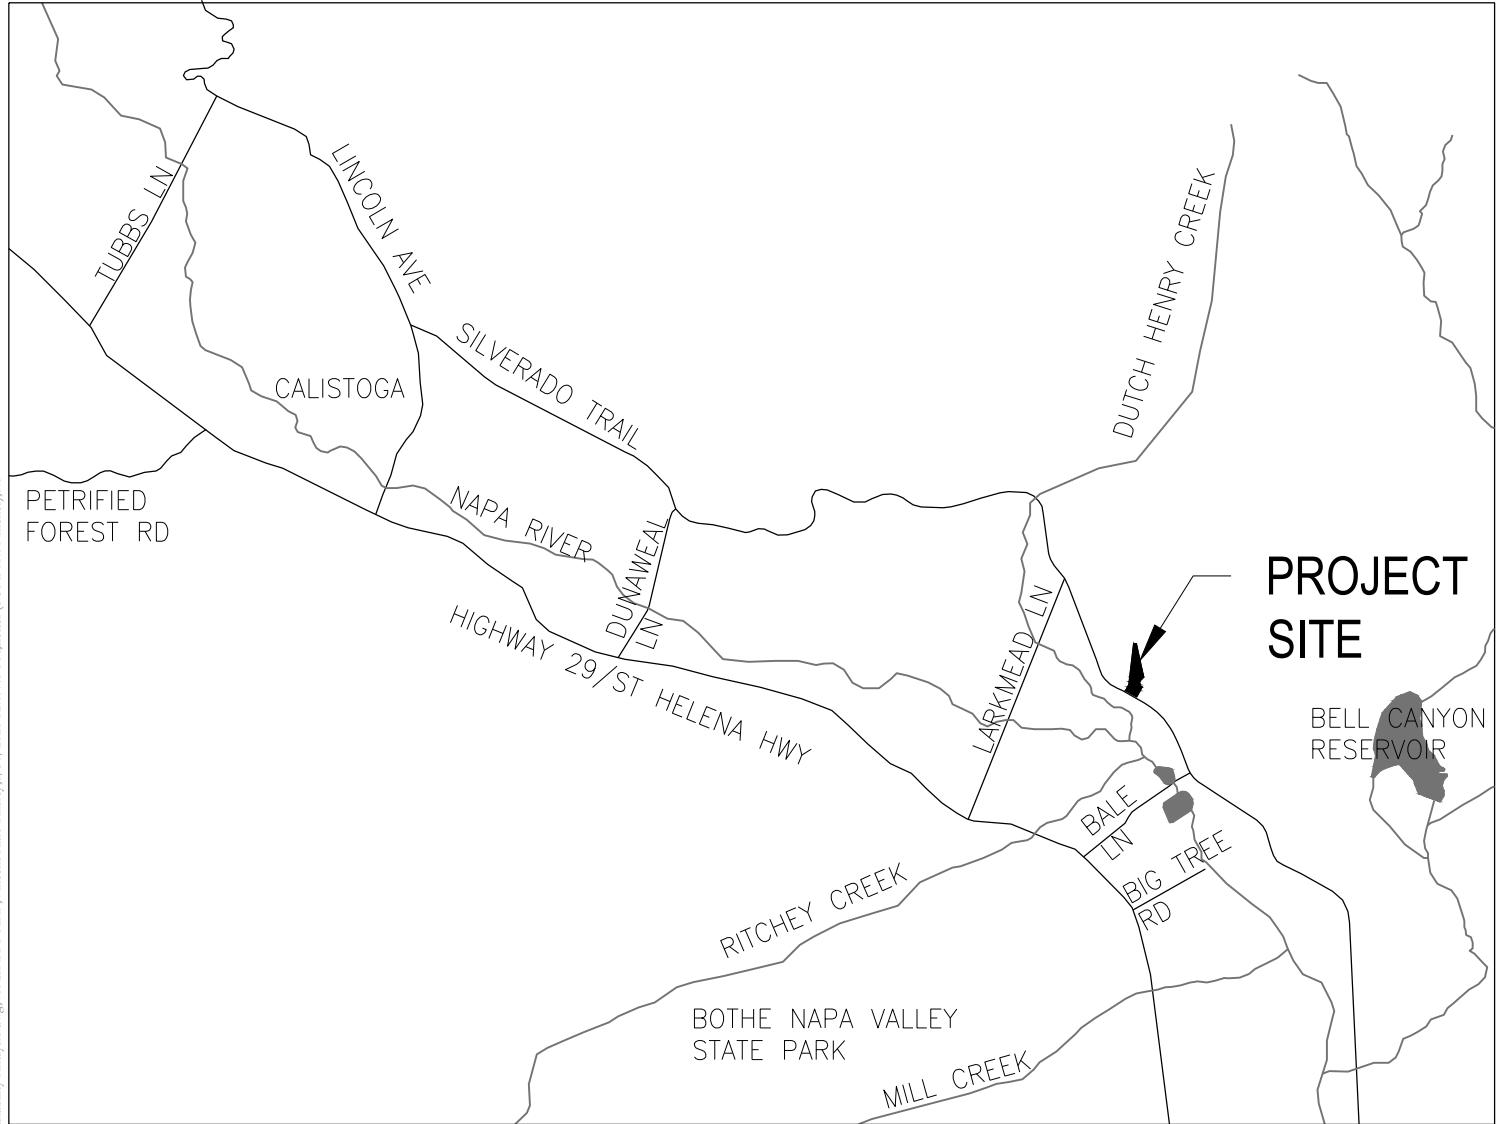

## VICINITY MAP

NOT TO SCALE



2548 Mission Street  
San Francisco, CA 94110  
[www.sherwoodengineers.com](http://www.sherwoodengineers.com)

LADERA WINERY  
CALISTOGA, CALIFORNIA

Please attach an 8.5" x 11" plot map showing the locations of all test pits triangulated from permanent landmarks or known property corners. The map must be drawn to scale and include a North arrow, surrounding geographic and topographic features, direction and % slope, distance to drainages, water bodies, potential areas for flooding, unstable landforms, existing or proposed roads, structures, utilities, domestic water supplies, wells, ponds, existing wastewater treatment systems and facilities.

Permit #:

APN: 021-030-043-000

(County Use Only)  
Reviewed by:

Date:

**PLEASE PRINT OR TYPE ALL INFORMATION**

Property Owner <b>LADERA WINERY</b>			<input checked="" type="checkbox"/> New Construction <input type="checkbox"/> Addition <input type="checkbox"/> Remodel <input type="checkbox"/> Relocation <input type="checkbox"/> Other:
Property Owner Mailing Address <b>3942 SILVERADO TRAIL N</b>			<input checked="" type="checkbox"/> Residential - # of Bedrooms: 3      Design Flow : 450 gpd
City <b>CALISTOGA</b>	State <b>CA</b>	Zip <b>94515</b>	<input checked="" type="checkbox"/> Commercial – Type:  Sanitary Waste: 315 gpd      Process Waste: gpd <input checked="" type="checkbox"/> Other:  Sanitary Waste: gpd      Process Waste: 1,000 gpd
Site Address/Location <b>3942 SILVERADO TRAIL N CALISTOGA, CA 94515</b>			

**Evaluation Conducted By:**

Company Name <b>Sherwood Design Engineers</b>	Evaluator's Name <b>Christina Nicholson, PE</b>	Signature (Civil Engineer, R.E.H.S., Geologist, Soil Scientist) <b>Christina Nicholson, PE</b>
Mailing Address: <b>625 2nd ST STE 202</b>		Telephone Number <b>415-677-7300</b>
City <b>Petaluma</b>	State <b>CA</b>	Zip <b>94952</b>
		Date Evaluation Conducted <b>11/17/2021</b>

<b>Primary Area</b>		<b>Expansion Area</b>	
Acceptable Soil Depth: 67 & 70 in.      Test pit #'s: 4 & 5  Soil Application Rate (gal. /sq. ft. /day): 0.8  System Type(s) Recommended: PRESSURIZED LEACH FIELD  Slope: 0-2 %.      Distance to nearest water source: 100+ ft.  Hydrometer test performed?      No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> (attach results) Bulk Density test performed?      No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> (attach results) Percolation test performed?      No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> (attach results) Groundwater Monitoring Performed? No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> (attach results)		Acceptable Soil Depth: 52 & 48 in.      Test pit #'s: 1 & 2  Soil Application Rate (gal. /sq. ft. /day): 0.8  System Type(s) Recommended: PRESSURIZED LEACH FIELD  Slope: 0-2 %.      Distance to nearest water source: 100+ ft.  Hydrometer test performed?      No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> (attach results) Bulk Density test performed?      No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> (attach results) Percolation test performed?      No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> (attach results) Groundwater Monitoring Performed? No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> (attach results)	
Site constraints/Recommendations:  A site evaluation was performed on November 17, 2021 by Christina Nicholson and Vincent Hart-Tinsley of Sherwood Design Engineers. Test pits were excavated by McCollum General Engineering using an excavator with a 24" bucket. Maureen Shields-Bown of Napa County Environmental Health visited the site to inspect soil conditions. Test pits 1-8 showed suitable soil for the installation of a Pressurized Leachfield within area tested with required replacement area.			

### Test Pit #

### \*Hydrometer Test Performed

Horizon Depth (Inches)	Boundary	%Rock	Texture	Structure	Consistence			Pores	Roots	Mottling
					Side Wall	Ped	Wet			
0-44*		0-10	SCL	M, AB	SH	FRB	SS	M:VF M:F	C:F M:VF F:C	None
44-66	D	10-20	SCL	M, G	SH	FRB	SS	M:VF M:F	F:C	None

### Test Pit #

### \*Hydrometer Test Performed

Horizon Depth (Inches)	Boundary	%Rock	Texture	Structure	Consistence			Pores	Roots	Mottling
					Side Wall	Ped	Wet			
0-25		0-10	SL	M, AB	SH	FRB	SS	M:VF M:F	C:F M:VF F:C	None
25-65*	D	10-20	SL	M, G	SH	FRB	SS	M:VF M:F	F:C	None

### Test Pit #

3

Horizon Depth (Inches)	Boundary	%Rock	Texture	Structure	Consistence			Pores	Roots	Mottling
					Side Wall	Ped	Wet			
0-24		0-10	SCL	M, AB	SH	FRB	SS	M:VF M:F	C:F M:VF F:C	None
24-68	D	10-20	SCL	M, G	SH	FRB	SS	M:VF M:F	C:F M:VF F:C	None

### Test Pit #

### \*Hydrometer Test Performed

Horizon Depth (Inches)	Boundary	%Rock	Texture	Structure	Consistence			Pores	Roots	Mottling
					Side Wall	Ped	Wet			
0-27		0-10	SL	M, AB	SH	FRB	SS	M:VF M:F	F:M M:F M:VF	None
27-67*	D	10-20	SL	M, G	SH	FRB	SS	M:VF M:F	C:C	None

### Test Pit #

### \*Hydrometer Test Performed

Horizon Depth (Inches)	Boundary	%Rock	Texture	Structure	Consistence			Pores	Roots	Mottling
					Side Wall	Ped	Wet			
0-28		0-10	SL	M, AB	SH	FRB	SS	M:VF M:F	F:EXC M:F F:C M:VF	None
28-70*	D	10-20	SL	M, G	SH	FRB	SS	M:VF M:F	M:F C:C	None

### Test Pit #

6

### Test Pit #

7

### \*Hydrometer Test Performed

### Test Pit #

8

### \*Hydrometer Test Performed


### Test Pit #

1

## ABBREVIATIONS

Boundary	Texture	Structure	Consistence			Pores	Roots	Mottling
A=Abrupt <1"	S=Sand	W=Weak	Side Wall	Ped	Wet	Quantity:	Quantity:	Quantity:
C=Clear 1"-2.5"	LS=Loamy Sand	M=Moderate	L=Loose	L=Loose	NS=NonSticky	F=Few	F=Few	F=Few
G=Gradual 2.5"-5"	SL=Sandy Loam	S=Strong	S=Soft	VFRB=Very Friable	SS=Slightly Sticky	C=Common	C=Common	C=Common
D=Difuse >5"	SCL=Sandy Clay Loam	G=Granular	SH=Slightly Hard	FRB=Friable	S=Sticky	M=Many	M=Many	M=Many
	SC=Sandy Clay	PI=Platy	H=Hard	F=Firm	VS=Very Sticky	<u>Size:</u>	<u>Size:</u>	<u>Size:</u>
	CL=Clay Loam	Pr=Prismatic	VH=Very Hard	VF=Very Firm	NP=NonPlastic	VF=Very Fine	F=Fine	F=Fine
	L=Loam	C=Columnar	ExH=Extremely Hard	ExF=Extremely Firm	SP=Slightly Plastic	F=Fine	M=Medium	M=Medium
	C=Clay	AB=Angular			P=Plastic	C=Coarse	VC=Very Coarse	C=Coarse
	SiC=Silty Clay	SB=Subangular			VP=Very Plastic	VC=Very Coarse	ExC=Extremely Coarse	Prominent
	SiCL=Silty Clay Loam	Blocky						
	SiL=Silt Loam	M=Massive						
	Si=Silt	SG=Single Grain						
		C=Cemented						

## U.S.D.A. SOIL CLASSIFICATION TRIANGLE

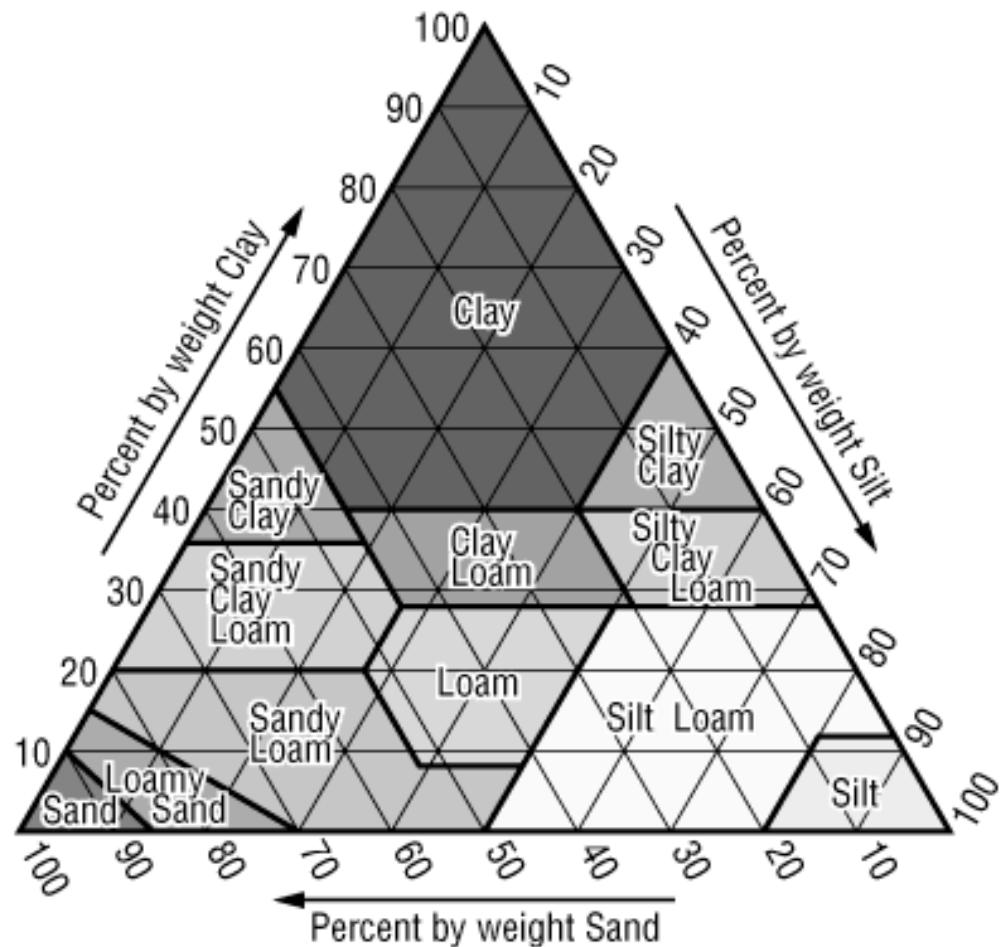

## ALTERNATIVE SEWAGE TREATMENT SYSTEM SOIL APPLICATION RATES

TEXTURE	STRUCTURE		Application Rate (Gal/ft <sup>2</sup> /day)	
	Shape	Grade	STE <sup>1</sup>	PTE <sup>1,2</sup>
Coarse sand, sand, loamy coarse sand	Single grain	Structureless	1.0	1.2
Fine Sand, loamy fine sand	Single grain	Structureless	0.6	1.0
Sandy Loam, Loamy Sand	Massive	Structureless	0.35	0.5
	Platy	Weak	0.35	0.5
	Prismatic, blocky, granular	Weak	0.5	0.75
		Moderate, strong	0.8	1.0
Loam, Silt Loam, Sandy Clay Loam, Fine Sandy Loam	Massive	Structureless		
	Platy	Weak, mod, strong		
	Prismatic, blocky, granular	Weak, Moderate	0.5	0.75
		Strong	0.8	1.0
Sandy clay, Silty clay loam, Clay Loam	Massive	Structureless		
	Platy	Weak, moderate, strong		
	Prismatic, blocky, granular	Weak, Moderate	0.35	0.5
		Strong	0.6	0.75
Clay, Silty clay	Massive	Structureless		
	Platy	Weak, mod, strong		
	Prismatic, blocky, granular	Weak		
		Moderate, strong	0.2	0.25

1: See Table 1 in the Design, Construction, and Installation of Alternative Sewage Treatment Systems.

2: A higher application rate for pretreated effluent may only be used when pretreatment is not used for one foot of vertical separation credit.

MINIMUM SURFACE AREA GUIDELINES TO DISPOSE OF 100 GPD OF SECONDARY TREATED EFFLUENT FOR SUBSURFACE DRIP DISPERSAL SYSTEMS					
Soil Class	Soil Type	Soil Absorption Rates		Design Application Rate (Gal/ft <sup>2</sup> /day)	Total Area Required Sq. ft. /100 gallons per day
		Est. Soil Perc. Rate minutes/in.	Hydraulic Conductivity inches/hr.		
I	Coarse sand	1-5	>2	1.400	71.5
I	Fine sand	5 - 10	1.5 - 2	1.200	83.3
II	Sandy loam	10 - 20	1.0 - 1.5	1.000	100.0
II	loam	20 - 30	0.75 - 1.0	0.700	143.0
III	Clay loam	30 - 45	0.5 - 0.75	0.600	167.0
III	Silt - clay loam	45 - 60	0.3 - 0.5	0.400	250.0
IV	Clay non-swell	60 - 90	0.2 - 0.3	0.200	500.0
IV	Clay - swell	90 - 120	0.1 - 0.2	0.100	1000.0

1. For design purpose, the "Soil Type" category to be used in the above table shall be based on the most restrictive soil type encountered within two feet below the bottom of the drip line.

2. Dispersal field area calculation: Total square feet area of dispersal field = Design flow divided by loading rate.

## CONVENTIONAL SEWAGE TREATMENT SYSTEM SOIL APPLICATION RATES

TEXTURE	STRUCTURE		Application Rate (Gal/ft <sup>2</sup> /day)
	Shape	Grade	
Coarse Sand, Sand, Loamy Coarse Sand	Single grain	Structureless	
Sandy Loam, Loamy Sand	Massive	Structureless	
	Platy	Weak, mod, strong	
	Prismatic, blocky, granular	Weak	0.33
		Moderate, strong	0.5
Loam, Silt Loam, Sandy Clay Loam, Fine Sandy Loam	Massive	Structureless	
	Platy	Weak, mod, strong	
	Prismatic, blocky, granular	Weak	0.25
		Moderate, strong	0.33
Clay loam	Massive	Structureless	
	Platy	Weak, mod, strong	
	Prismatic, blocky, granular	Weak, moderate	0.25
		Strong	0.33
Sandy Clay, Silty Clay Loam	Massive	Structureless	
	Platy	Weak, moderate, strong	
	Prismatic, blocky, granular	Weak, moderate	
		Strong	0.25
Clay, Silty Clay	Massive	Structureless	
	Platy	Weak, mod, strong	
	Prismatic, blocky, granular	Weak	
		Moderate, strong	

  = Conventional system prohibited

## CONVENTIONAL SEWAGE TREATMENT SYSTEM SOIL APPLICATION RATES BASED ON PERCOLATION RATES

Percolation Rate (mpi)	Application Rate (STE)
<5 MPI	Prohibited
5 to 10 MPI	0.5
10-20 MPI	0.33
20-60 MPI	0.25
> 60 MPI	Prohibited

**TABLE 1****DRIP LOADING RATES CONSIDERING SOIL STRUCTURE.**

Table 1 is taken from the State of Wisconsin code and was prepared by Jerry Tyler.

Provided for guidelines and budgeting purposes. Refer to your local regulations and qualified soil scientists to determine best loading rates.

Soil Textures	Soil Structure	Maximum Monthly Average <b>BOD<sub>5</sub>&lt;30mg/L</b> <b>TSS&lt;30mg/L</b> (gallons/ft <sup>2</sup> /day)	Maximum Monthly Average <b>BOD<sub>5</sub>&gt;30mg/L</b> <b>TSS&gt;30mg/L</b> (gallons/ft <sup>2</sup> /day)
Course sand or coarser	N/A	1.6	0.4
Loamy coarse sand	N/A	1.4	0.3
Sand	N/A	1.2	0.3
Loamy sand	Weak to strong	1.2	0.3
Loamy sand	Massive	0.7	0.2
Fine sand	Moderate to strong	0.9	0.3
Fine sand	Massive or weak	0.6	0.2
Loamy fine sand	Moderate to strong	0.9	0.3
Loamy fine sand	Massive or weak	0.6	0.2
Very fine sand	N/A	0.6	0.2
Loamy very fine sand	N/A	0.6	0.2
Sandy loam	Moderate to strong	0.9	0.2
Sandy loam	Weak, weak platy	0.6	0.2
Sandy loam	Massive	0.5	0.1
Loam	Moderate to strong	0.8	0.2
Loam	Weak, weak platy	0.6	0.2
Loam	Massive	0.5	0.1
Silt loam	Moderate to strong	0.8	0.2
Silt loam	Weak, weak platy	0.3	0.1
Silt loam	Massive	0.2	0.0
Sandy clay loam	Moderate to strong	0.6	0.2
Sandy clay loam	Weak, weak platy	0.3	0.1
Sandy clay loam	Massive	0.0	0.0
Clay loam	Moderate to strong	0.6	0.2
Clay loam	Weak, weak platy	0.3	0.1
Clay loam	Massive	0.0	0.0
Silty clay loam	Moderate to strong	0.6	0.2
Silty clay loam	Weak, weak platy	0.3	0.1
Silty clay loam	Massive	0.0	0.0
Sandy clay	Moderate to strong	0.3	0.1
Sandy clay	Massive to weak	0.0	0.0
Clay	Moderate to strong	0.3	0.1
Clay	Massive to weak	0.0	0.0
Silty clay	Moderate to strong	0.3	0.1
Silty clay	Massive to weak	0.0	0.0



**Santa Rosa Office**  
1305 North Dutton Ave.  
Santa Rosa, CA 95401  
P: 707-544-1072  
F: 707-544-1082

**Napa Office**  
1041 Jefferson St.  
Napa, CA 94559  
P: 707-252-8105  
F: 707-544-1082

**Middletown Office**  
P.O. Box 652  
Middletown, CA 95461  
P: 707-987-4602  
F: 707-987-4603

## Bouyoucos Hydrometer

<b>Client:</b>	<b>Sherwood Design Engineers</b>	<b>Sampled:</b>	<b>11/17/2021</b>
<b>Project:</b>	<b>Ladera</b>	<b>Received:</b>	<b>11/17/2021</b>
<b>Project #:</b>	<b>9360.3</b>	<b>Reported:</b>	<b>11/27/2021</b>
<b>Client Project #:</b>	<b>Not Stated</b>		

Sample Number	TP-1	TP-2	TP-4					
Depth	H-1	H-2	H-2					
A. Oven Dry Wt.	50.0	50.0	50.0					
B. Starting Time (hr:min)	12:23	12:21	12:19					
C. Temp. @ 40 sec. (F)	65.1	65.1	65.1					
D. Hydro Reading @ 40 sec.	28.5	26.5	24.0					
E. Composite Correction	-5.2	-5.2	-5.2					
F. True Density @ 40 sec. (D-E)	23.3	21.3	18.8					
G. Temp. @ 2 hrs. (F)	64.0	63.9	64.0					
H. Hydro Reading @ 2 hrs.	16.0	15.5	14.0					
I. Comp. Correction	-5.3	-5.3	-5.3					
J. True Density @ 2 hrs. (H-I)	10.7	10.2	8.7					
K. % Sand=100-((F/A) x 100)	<b>53.4</b>	<b>57.4</b>	<b>62.4</b>					
L. % Clay= ((J/A) x 100)	<b>21.4</b>	<b>20.4</b>	<b>17.4</b>					
M. % Silt= 100-(K+L)	<b>25.2</b>	<b>22.2</b>	<b>20.2</b>					
N. % Retained #10=	<b>22.3</b>	<b>20.3</b>	<b>25.4</b>					
Dry Wt. Before Wash + Tare	338.3	424.4	450.7					
Dry Wt. After Wash + Tare	139.5	173.8	196.3					
Dry Wt. Passing #10	198.8	250.6	254.4					
Tare Weight	82.5	110.0	109.6					
Dry Wt. Before Wash	255.8	314.4	341.1					
% Passing #10	77.7	79.7	74.6					
% #10	22.3	20.3	25.4					



**Santa Rosa Office**  
1305 North Dutton Ave.  
Santa Rosa, CA 95401  
P: 707-544-1072  
F: 707-544-1082

**Napa Office**  
1041 Jefferson St.  
Napa, CA 94559  
P: 707-252-8105  
F: 707-544-1082

**Middletown Office**  
P.O. Box 652  
Middletown, CA 95461  
P: 707-987-4602  
F: 707-987-4603

## Bouyoucos Hydrometer

<b>Client:</b>	<b>Sherwood Design Engineers</b>	<b>Sampled:</b>	<b>11/17/2021</b>
<b>Project:</b>	<b>Ladera</b>	<b>Received:</b>	<b>11/17/2021</b>
<b>Project #:</b>	<b>9360.3</b>	<b>Reported:</b>	<b>11/27/2021</b>
<b>Client Project #:</b>	<b>Not Stated</b>		

<b>Sample Number</b>	<b>TP-5</b>	<b>TP-7</b>						
<b>Depth</b>	<b>H-2</b>	<b>H-1</b>						
<b>A. Oven Dry Wt.</b>	<b>50.0</b>	<b>50.0</b>						
<b>B. Starting Time (hr:min)</b>	<b>12:17</b>	<b>12:15</b>						
<b>C. Temp. @ 40 sec. (F)</b>	<b>65.1</b>	<b>65.5</b>						
<b>D. Hydro Reading @ 40 sec.</b>	<b>23.5</b>	<b>25.0</b>						
<b>E. Composite Correction</b>	<b>-5.2</b>	<b>-5.1</b>						
<b>F. True Density @ 40 sec. (D-E)</b>	<b>18.3</b>	<b>19.9</b>						
<b>G. Temp. @ 2 hrs. (F)</b>	<b>63.9</b>	<b>63.9</b>						
<b>H. Hydro Reading @ 2 hrs.</b>	<b>14.0</b>	<b>15.0</b>						
<b>I. Comp. Correction</b>	<b>-5.3</b>	<b>-5.3</b>						
<b>J. True Density @ 2 hrs. (H-I)</b>	<b>8.7</b>	<b>9.7</b>						
<b>K. % Sand=100-((F/A) x 100)</b>	<b>63.4</b>	<b>60.2</b>						
<b>L. % Clay= ((J/A) x 100)</b>	<b>17.4</b>	<b>19.4</b>						
<b>M. % Silt= 100-(K+L)</b>	<b>19.2</b>	<b>20.4</b>						
<b>N. % Retained #10=</b>	<b>21.2</b>	<b>23.3</b>						
<b>Dry Wt. Before Wash + Tare</b>	<b>434.3</b>	<b>376.9</b>						
<b>Dry Wt. After Wash + Tare</b>	<b>178.7</b>	<b>153.4</b>						
<b>Dry Wt. Passing #10</b>	<b>255.6</b>	<b>223.5</b>						
<b>Tare Weight</b>	<b>110.0</b>	<b>85.4</b>						
<b>Dry Wt. Before Wash</b>	<b>324.3</b>	<b>291.5</b>						
<b>% Passing #10</b>	<b>78.8</b>	<b>76.7</b>						
<b>% #10</b>	<b>21.2</b>	<b>23.3</b>						

**Santa Rosa Office**

1305 North Dutton Ave.  
Santa Rosa, CA 95401  
P: 707-544-1072  
F: 707-544-1082

**Napa Office**

1041 Jefferson St.  
Napa, CA 94559  
P: 707-252-8105  
F: 707-544-1082


**Middletown Office**

P.O. Box 652  
Middletown, CA 95461  
P: 707-987-4602  
F: 707-987-4603

## Bouyoucos Hydrometer

<b>Client:</b>	<b>Sherwood Design Engineers</b>	<b>Sampled:</b>	<b>11/17/2021</b>
<b>Project:</b>	<b>Ladera</b>	<b>Received:</b>	<b>11/17/2021</b>
<b>Project #:</b>	<b>9360.3</b>	<b>Reported:</b>	<b>11/27/2021</b>
<b>Client Project #:</b>	<b>Not Stated</b>		

ZONE 1 = COARSE  
ZONE 2 = ACCEPTABLE  
ZONE 3 = MARGINAL  
ZONE 4 = UNACCEPTABLE

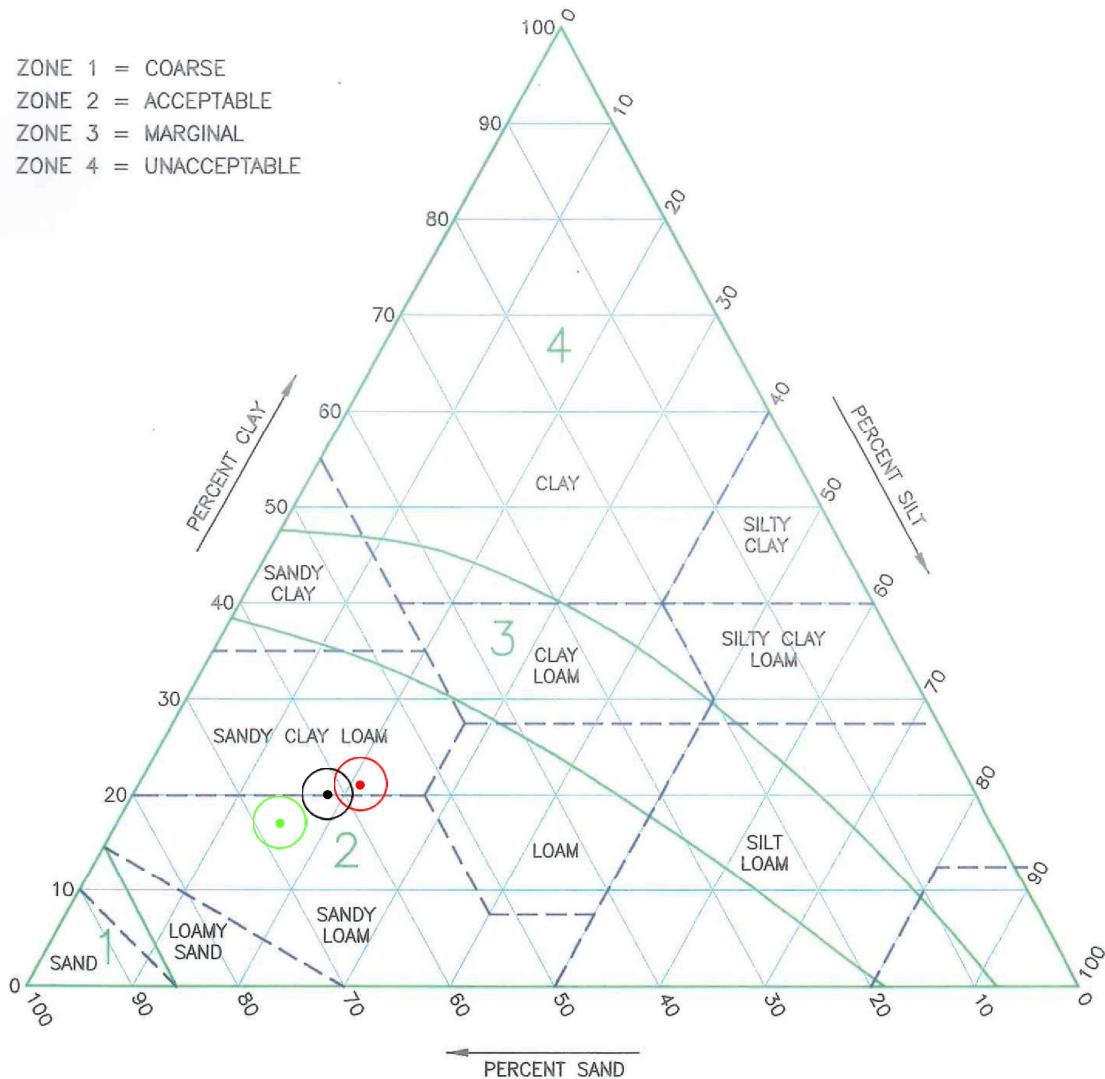

Legend

TP-1 @ H-1	TP-2 @ H-2
TP-4 @ H-2	

**Santa Rosa Office**

1305 North Dutton Ave.  
Santa Rosa, CA 95401  
P: 707-544-1072  
F: 707-544-1082

**Napa Office**

1041 Jefferson St.  
Napa, CA 94559  
P: 707-252-8105  
F: 707-544-1082


**Middletown Office**

P.O. Box 652  
Middletown, CA 95461  
P: 707-987-4602  
F: 707-987-4603

## Bouyoucos Hydrometer

<b>Client:</b>	<b>Sherwood Design Engineers</b>	<b>Sampled:</b>	<b>11/17/2021</b>
<b>Project:</b>	<b>Ladera</b>	<b>Received:</b>	<b>11/17/2021</b>
<b>Project #:</b>	<b>9360.3</b>	<b>Reported:</b>	<b>11/27/2021</b>
<b>Client Project #:</b>	<b>Not Stated</b>		

ZONE 1 = COARSE  
ZONE 2 = ACCEPTABLE  
ZONE 3 = MARGINAL  
ZONE 4 = UNACCEPTABLE

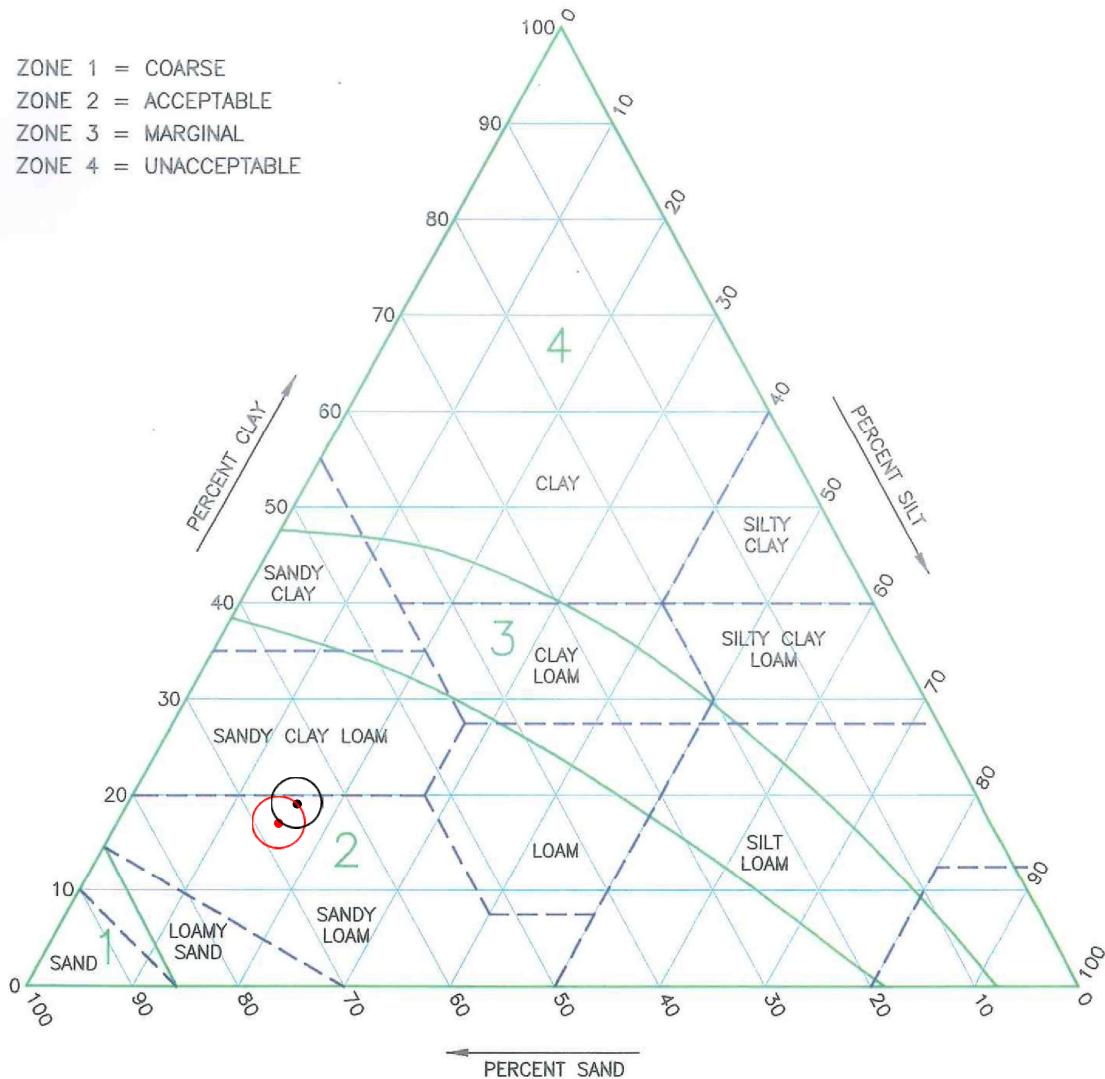

Legend

TP-5 @ H-2	TP-7 @ H-1



**AREA EXPLORED  
DURING SITE  
EVALUATION,  
SEE TEST PIT  
LOCATION MAP  
FOR DETAILS**



County of Napa




County of Napa | ITS Dept

Printed On: 11/18/2021

0 0.0275 0.055 0.11 mi

Disclaimer: This map was prepared for informational purposes only. No liability is assumed for the accuracy of the data delineated hereon.

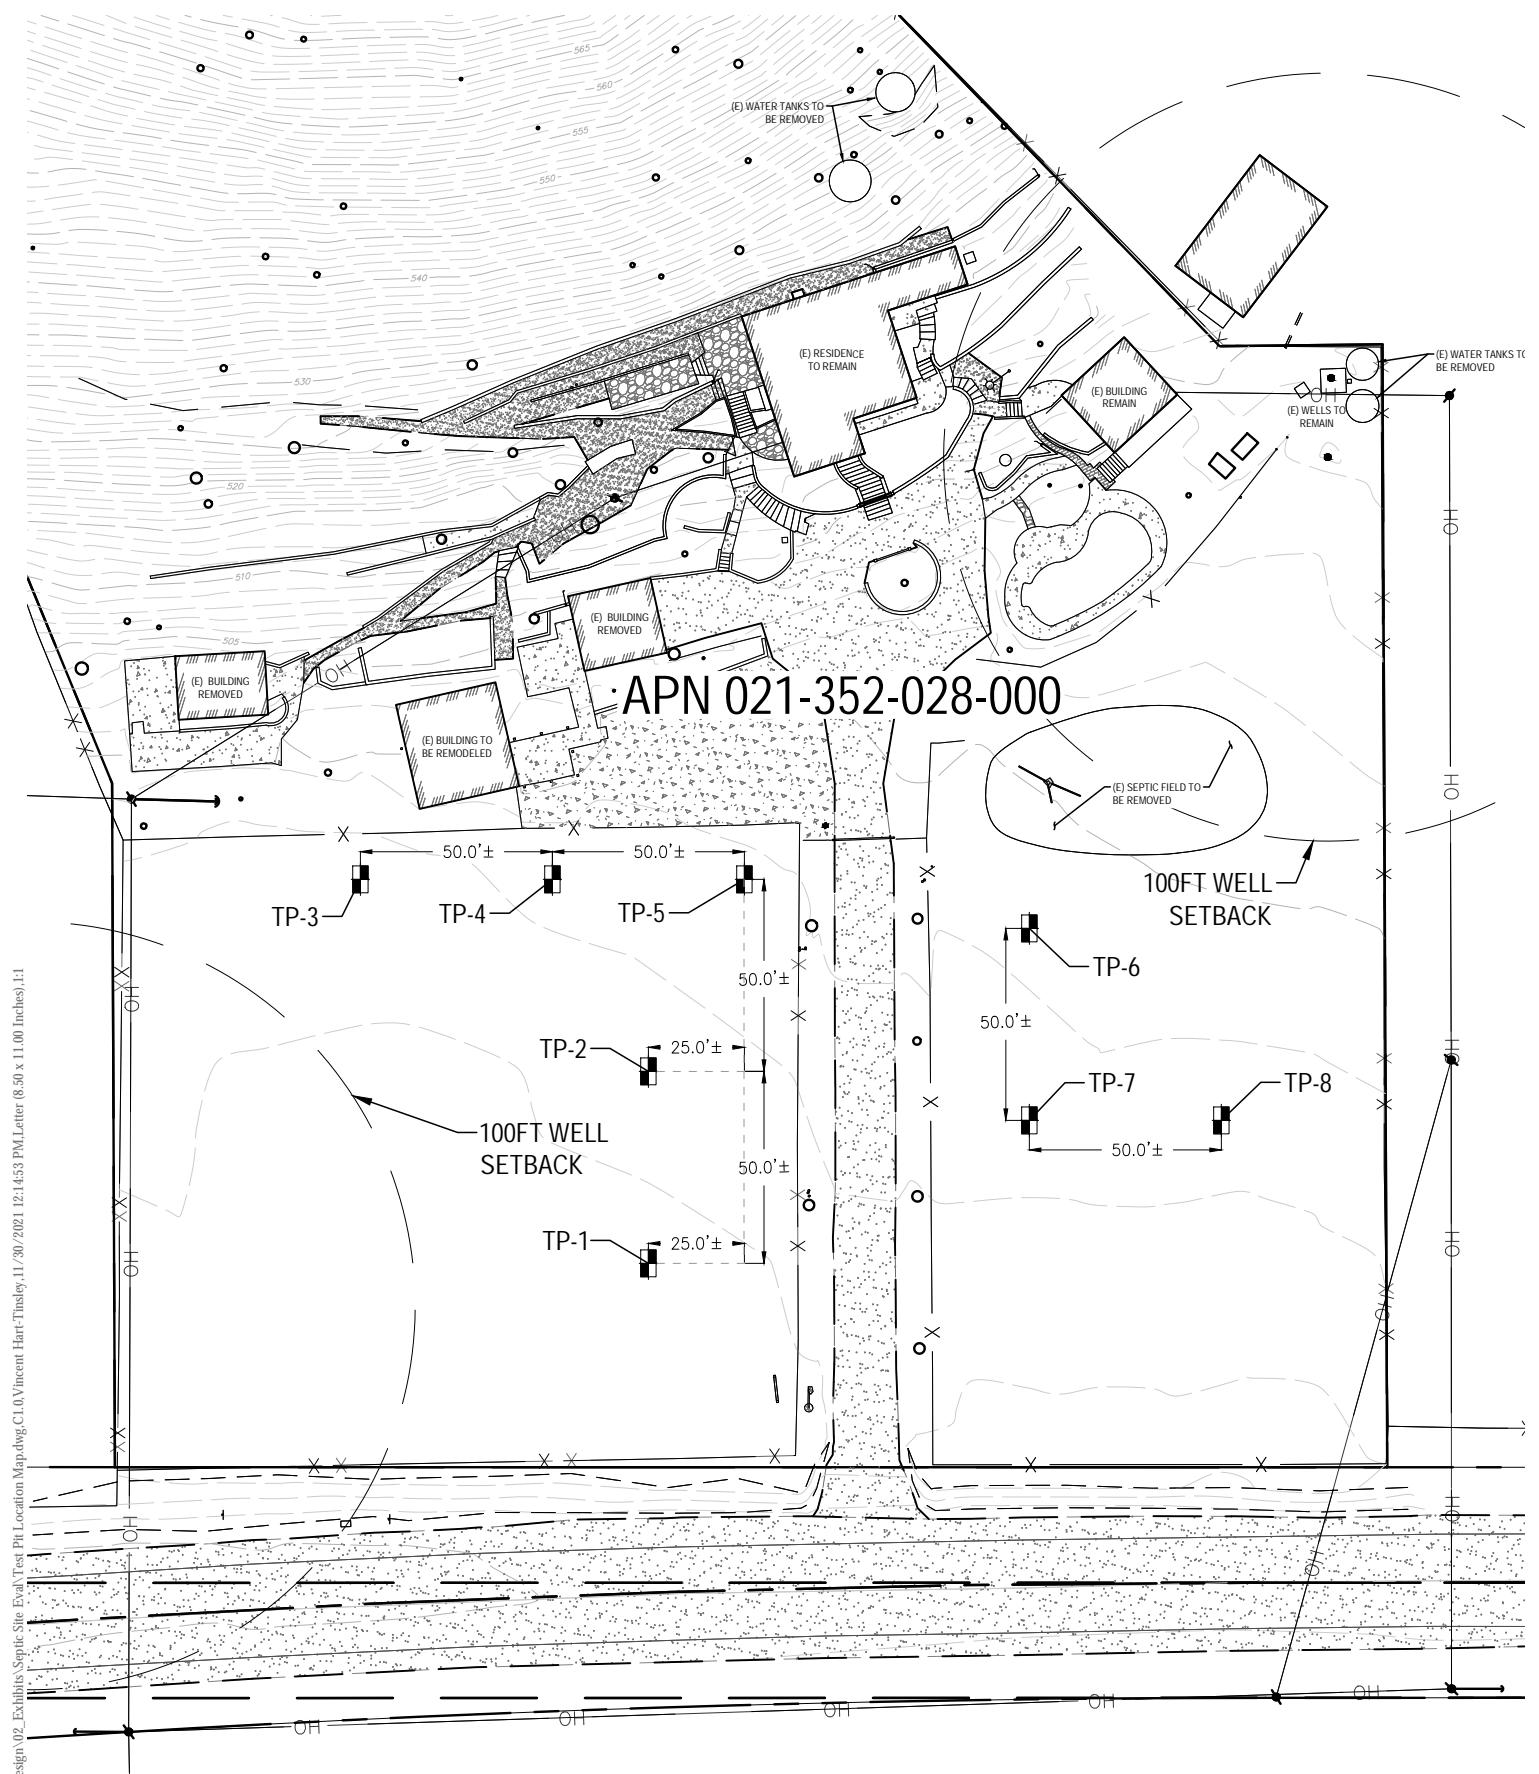

### TEST PIT LOCATION MAP

3942 SILVERADO TRAIL N  
CALISTOGA, CA 94515

DEC, 2021

**Attachment 3:**

Neighboring Parcel Research

State of California  
**Well Completion Report**  
Form DWR 188 Submitted 7/17/2018  
WCR2018-005573

Owner's Well Number	Date Work Began	04/13/2018	Date Work Ended	04/23/2018		
Local Permit Agency	Napa County Planning Building and Environmental Services					
Secondary Permit Agency	Permit Number	E18-00145		Permit Date	03/20/2018	
<b>Well Owner (must remain confidential pursuant to Water Code 13752)</b>					<b>Planned Use and Activity</b>	
Name	ALPHA OMEGA, ROBIN BAGGETT				Activity	New Well
Mailing Address	PO BOX 814				Planned Use	Water Supply Domestic
City	RUTHERFORD		State	CA	Zip	94573

<b>Well Location</b>											
Address			3950 SILVERADO TR			APN			021-030-002-000		
City		CALISTOGA		Zip	94515	County	Napa		Township		08 N
Latitude				N	Longitude		W		Range		06 W
Deg.	Min.	Sec.				Deg.	Min.	Sec.		Section	10
Dec. Lat.			38.5630970			Dec. Long.			-122.5110846		
Vertical Datum						Horizontal Datum			WGS84		
Location Accuracy						Location Determination Method					
Baseline Meridian Mount Diablo											
Ground Surface Elevation											
Elevation Accuracy											
Elevation Determination Method											

<b>Borehole Information</b>						<b>Water Level and Yield of Completed Well</b>					
Orientation	Vertical		Specify			Depth to first water	7	(Feet below surface)			
Drilling Method	Direct Rotary		Drilling Fluid			Bentonite					
Total Depth of Boring			335	Feet			Water Level	12	(Feet)	Date Measured	04/23/2018
Total Depth of Completed Well			335	Feet			Estimated Yield*	50	(GPM)	Test Type	Air Lift
Test Length 14 (Hours) Total Drawdown 67 (feet)											
*May not be representative of a well's long term yield.											

<b>Geologic Log - Free Form</b>											
Depth from Surface Feet to Feet		Description									
0	10	Topsoil									
10	40	40% GRAVEL, 30% SAND, 30% CLAY									
40	80	40% LARGE GRAVEL, 40% SAND, 20% CLAY									
80	120	50% GRAVEL, 40% SAND, 10% CLAY									
120	260	80% SMALL & LARGE GRAVEL, 20% SAND									
260	310	50% SHALE, 30% SAND, 20% SMALL GRAVEL									
310	315	50% WHITE ROCK, 50% RED ROCK									
315	335	60% SHALE, 25% SAND, 15% SMALL GRAVEL									

## Casings

Casing #	Depth from Surface Feet to Feet	Casing Type	Material	Casings Specifacations	Wall Thickness (inches)	Outside Diameter (inches)	Screen Type	Slot Size if any (inches)	Description
1	0	60	Blank	PVC OD: 6.625 in.   SDR: 21   Thickness: 0.316 in.	0.316	6.625			
1	60	180	Screen	PVC OD: 6.625 in.   SDR: 21   Thickness: 0.316 in.	0.316	6.625	Milled Slots	0	
1	180	200	Blank	PVC OD: 6.625 in.   SDR: 21   Thickness: 0.316 in.	0.316	6.625			
1	200	300	Screen	PVC OD: 6.625 in.   SDR: 21   Thickness: 0.316 in.	0.316	6.625	Milled Slots	0	
1	300	320	Blank	PVC OD: 6.625 in.   SDR: 21   Thickness: 0.316 in.	0.316	6.625			
1	320	335	Screen	PVC OD: 6.625 in.   SDR: 21   Thickness: 0.316 in.	0.316	6.625	Milled Slots	0	

## Annular Material

Depth from Surface Feet to Feet	Fill	Fill Type Details	Filter Pack Size	Description
0	51	Cement	Other Cement	6 SACK CEMENT
51	335	Filter Pack	Other Gravel Pack	3/8" Pea Gravel

## Other Observations:

### Borehole Specifications

Depth from Surface Feet to Feet	Borehole Diameter (inches)	
0	51	14
51	335	11

### Certification Statement

I, the undersigned, certify that this report is complete and accurate to the best of my knowledge and belief

Name MC LEAN & WILLIAMS INC  
 Person, Firm or Corporation  
878 EL CENTRO AVENUE NAPA CA 94558  
 Address City State Zip  
 Signed electronic signature received 07/17/2018 396352  
 C-57 Licensed Water Well Contractor Date Signed C-57 License Number

### Attachments

3950 Silverado Trail Well Location Map.pdf - Location Map


### DWR Use Only

CSG #	State Well Number				Site Code	Local Well Number			
					N				
Latitude Deg/Min/Sec									
Longitude Deg/Min/Sec									
TRS:									
APN:									



**Well Drilling & Pump Service**  
 878 El Centro Ave. Napa Ca, 94558  
 Office 707-255-6450  
 Fax 707-255-6489  
 Lic. #396352

**3950 Silverado Trail Calistoga Ap # 021-030-002**

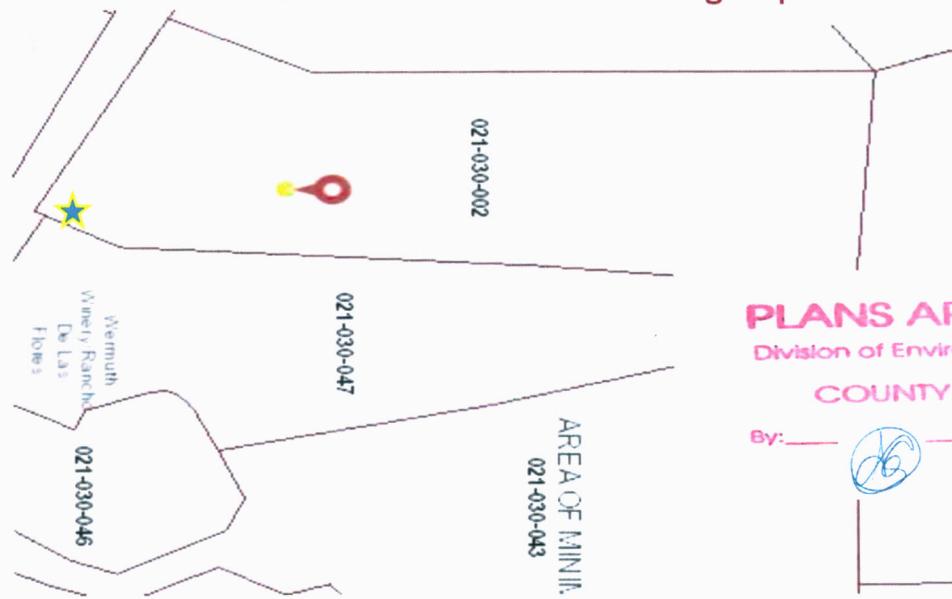

**PLANS APPROVED**

Division of Environmental Health

**COUNTY OF NAPA**

By: \_\_\_\_\_ Date: 03/20/18

JB



## PLANS APPROVED

E18-00145



SINCE 1949

Division of Environmental Health

## COUNTY OF NAPA

By: \_\_\_\_\_ Date: 03/20/18

3950 Silverado Trail Calistoga Ap # 021-030-002

page 2 of 2

